


## Main Menu Circle

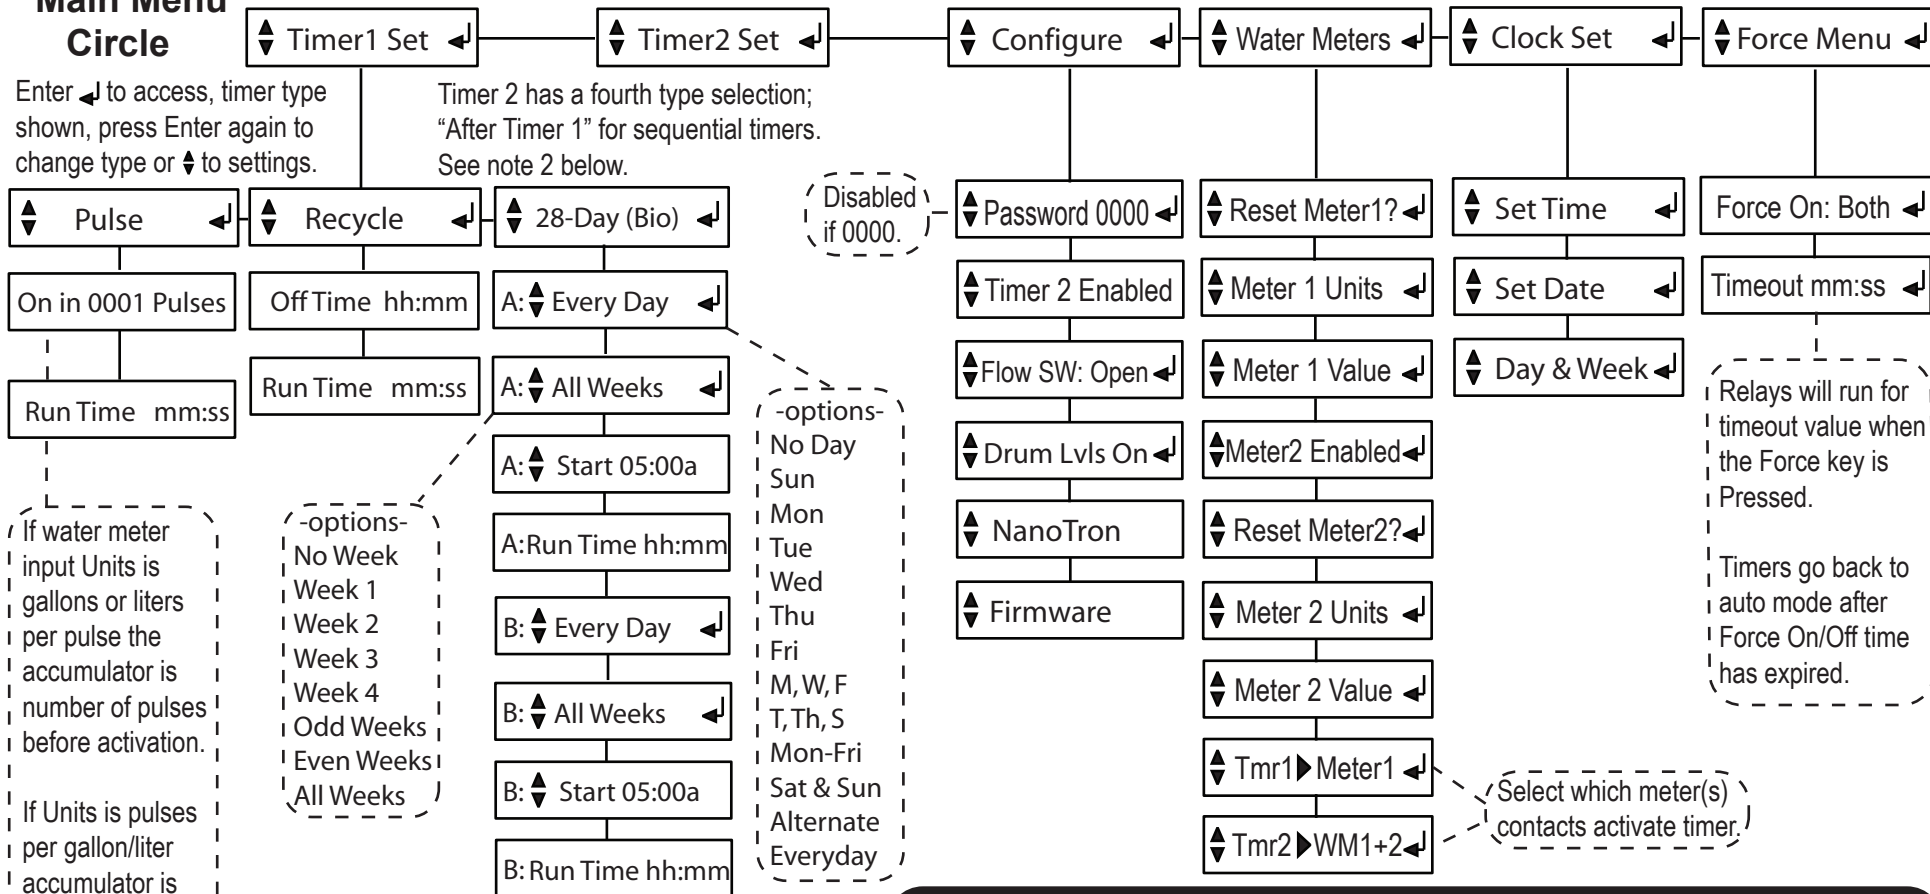

If water meter input Units is gallons or liters per pulse the accumulator is number of pulses before activation.

If Units is pulses per gallon/liter accumulator is number of gallons or liters before activation.

-options-  
No Week  
Week 1  
Week 2  
Week 3  
Week 4  
Odd Weeks  
Even Weeks  
All Weeks

-options-  
No Day  
Sun  
Mon  
Tue  
Wed  
Thu  
Fri  
M, W, F  
T, Th, S  
Mon-Fri  
Sat & Sun  
Alternate  
Everyday


Relays will run for timeout value when the Force key is Pressed.

Timers go back to auto mode after Force On/Off time has expired.

Select which meter(s) contacts activate timer.

### Notes:

1. If you press Menu while changing a value the value shown on the screen at the time will be entered as the new value.
2. If Timer 2 is set for "After Timer 1" it will activate it's Run Time each time Timer 1 completes a Run cycle.

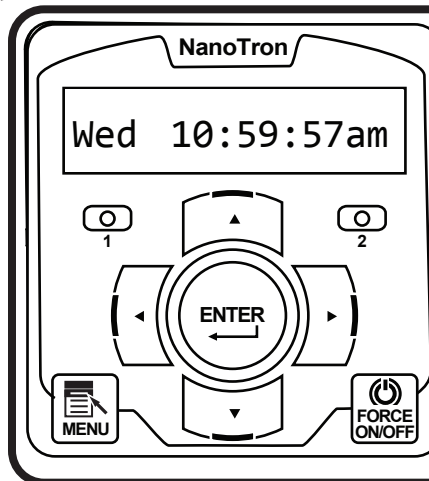

Press MENU to access menus or go back one layer in menu structure.

Press FORCE to activate relays, press again for Off and a third time back to auto.

Press ENTER to go a layer deeper in menu, to initiate a setting change and to set change.

Use up or down arrows to navigate through menu selections or setting options.

Use left or right arrows to move cursor while making a numerical value change.